


OR Set-up – Death by Circulatory Criteria (DCC)

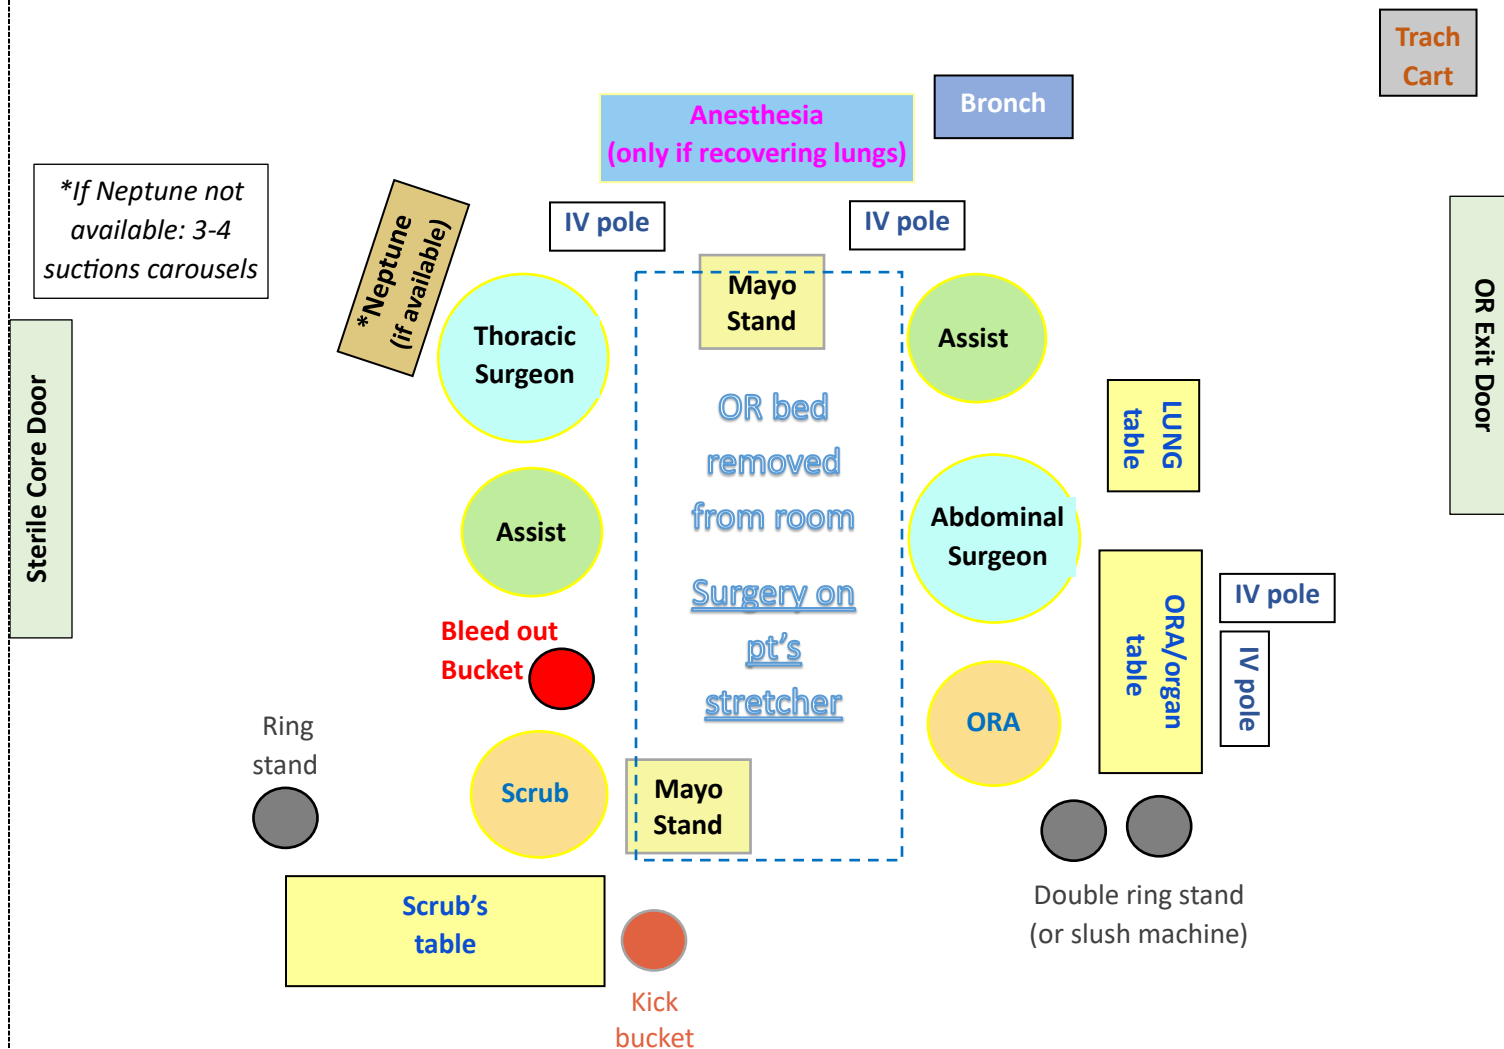

Note:

- Exact placement of equipment will vary based on specific OR design
- ORA/organ table should be oriented closest to the exit door with Scrub table on the opposite side.
- If Neptune not available, 3 suction carousels (4 suctions each) are required; a 4th carousel is requested, if possible.
- **If Lungs are NOT being recovered,** remove: Anesthesia, Bronch, trach cart, lung table, top mayo stand, 1 x IV pole